


Competitive Renewable Energy Zones (CREZ) Transmission Optimization Study

Figure 5: Scenario 2

1/29
V2

- DOUBLE CIRCUIT 345KV TRANSMISSION LINE
- SINGLE CIRCUIT 345KV TRANSMISSION LINE
- ADDITION OF SECOND CIRCUIT TO THE EXISTING 345KV STRUCTURE
- SINGLE CIRCUIT 138KV TRANSMISSION LINE
- ADDITION OF SECOND CIRCUIT TO THE EXISTING 138KV STRUCTURE
- EXISTING 345KV SUBSTATION
- EXISTING 138KV SUBSTATION
- NEW 345KV SUBSTATION
- NEW 345KV SUBSTATION WITH 345/138KV AUTOTRANSFORMER
- WIND POWER COLLECTION POINT

- Sharyland
- Oncor
- Cross Texas
- ETT
- Lone Star
- LCRA
- WETT

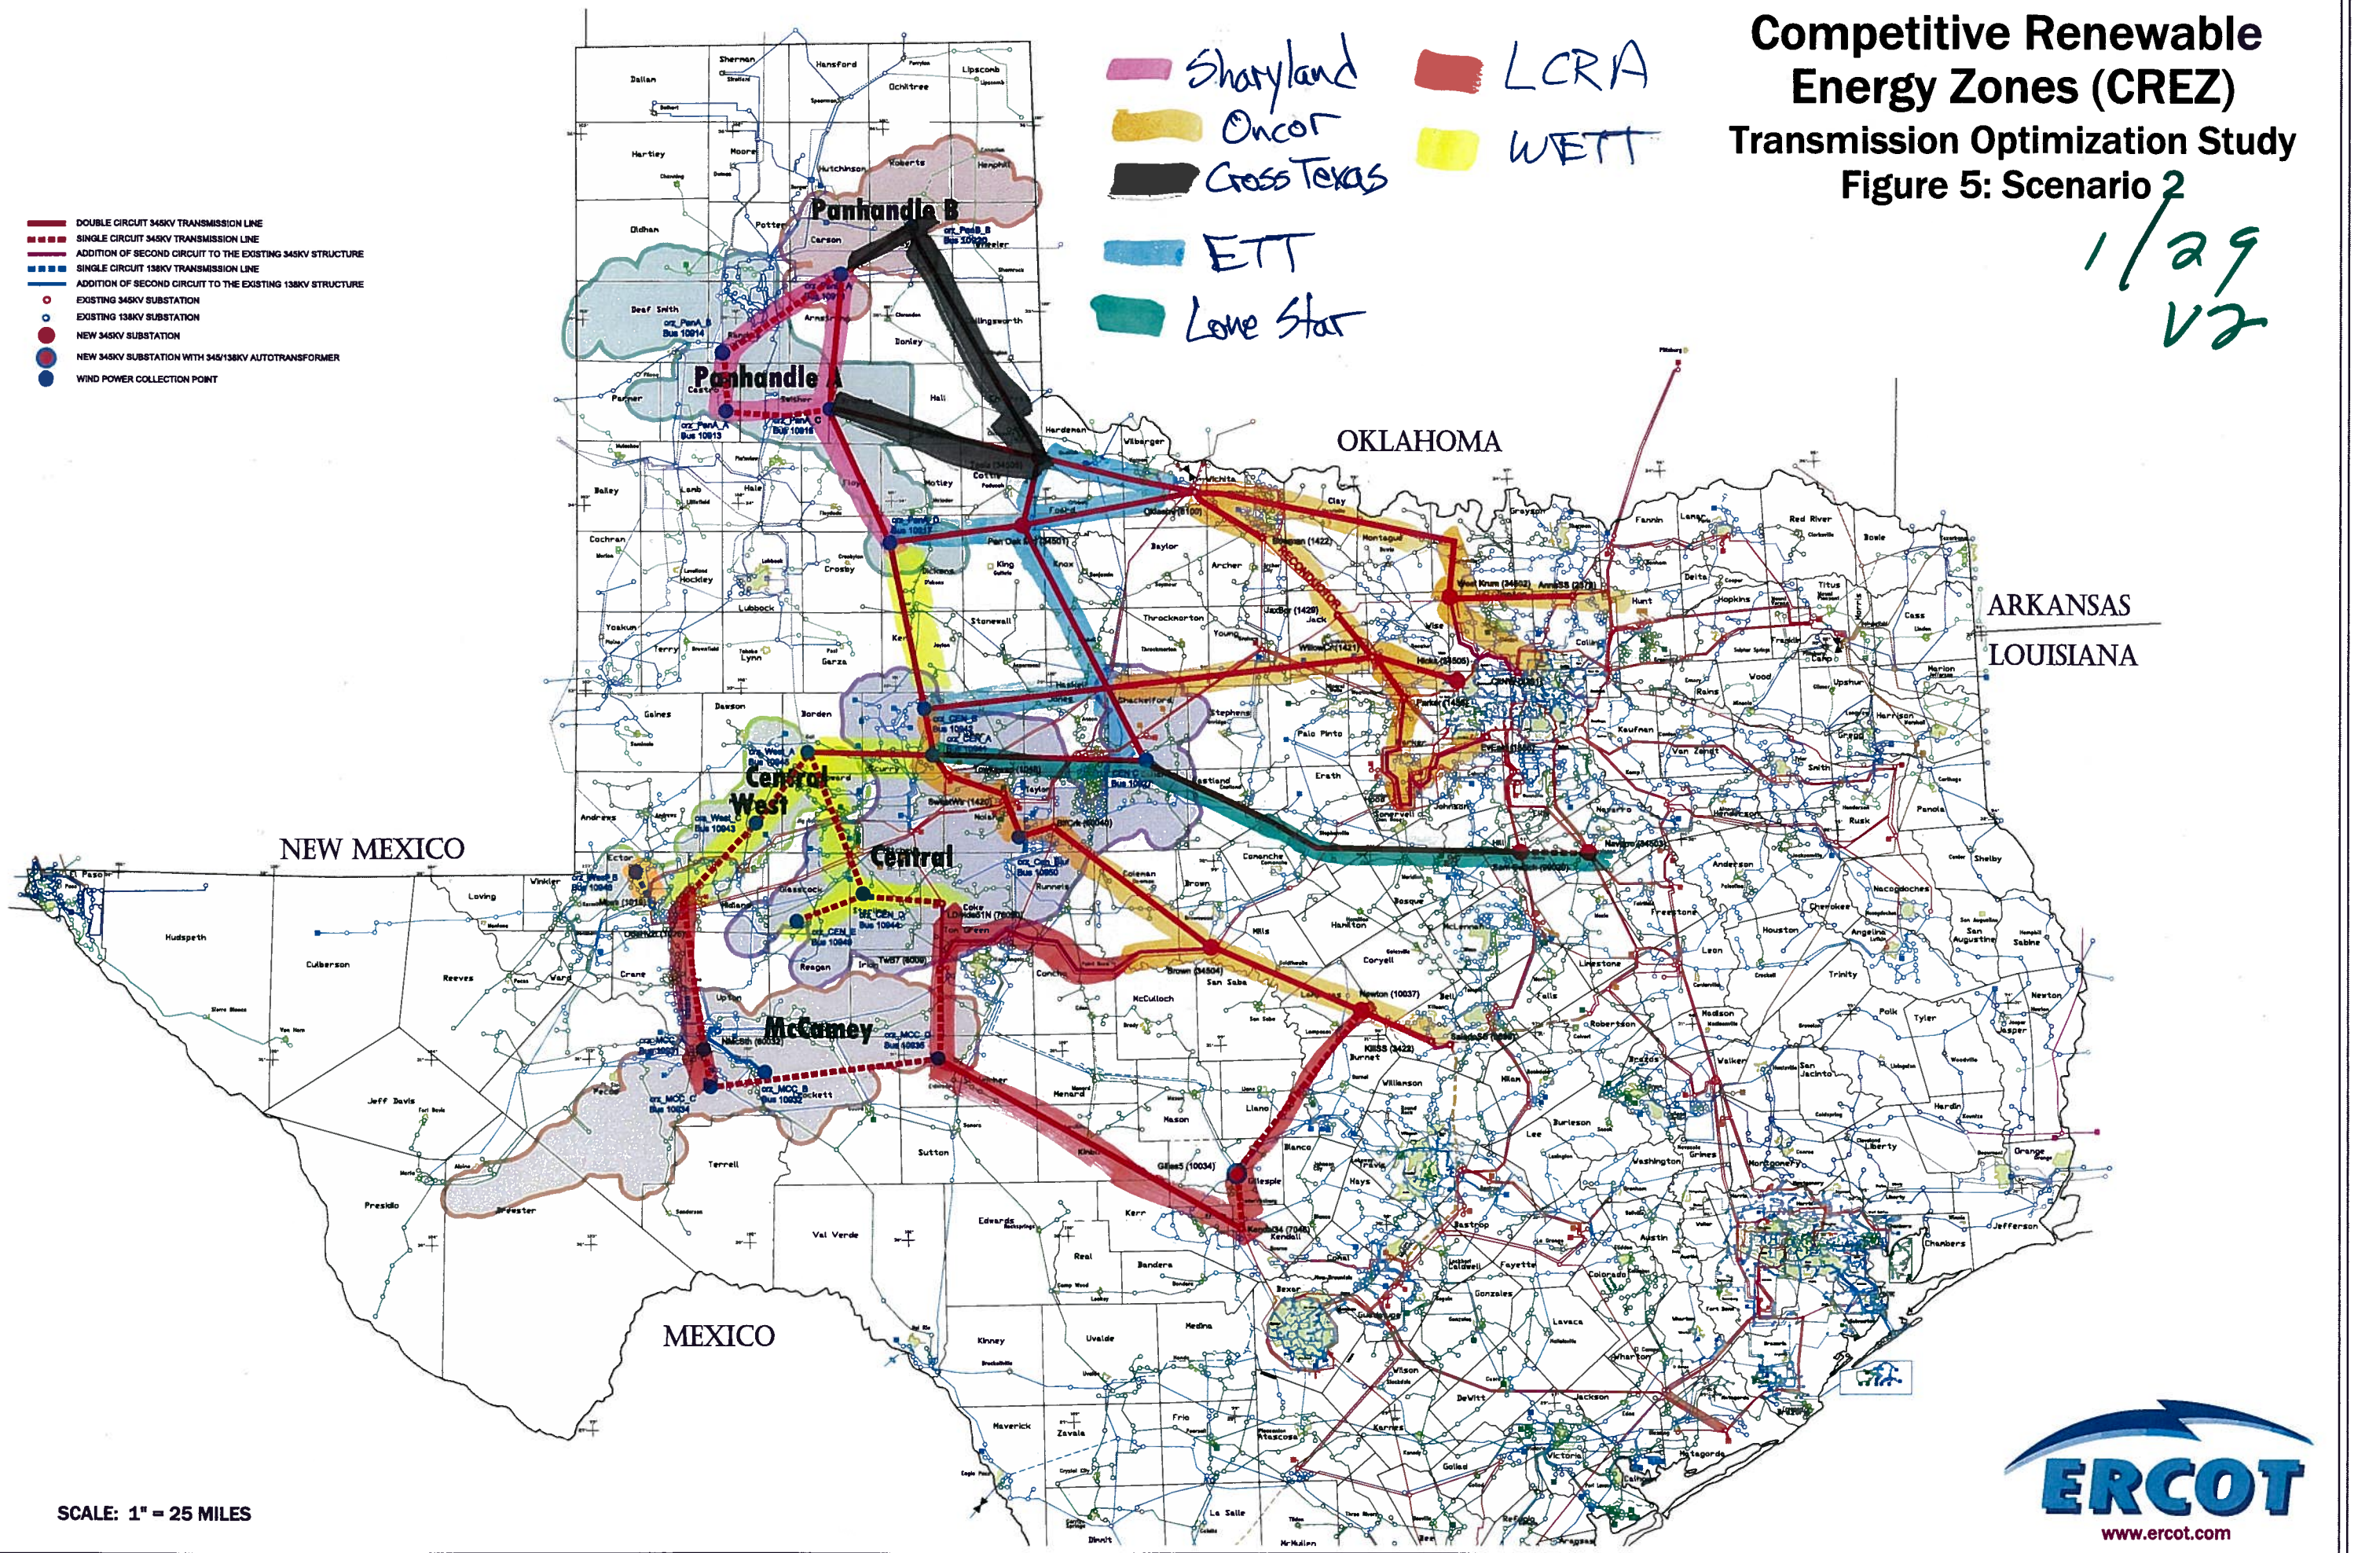

SCALE: 1" = 25 MILES

